

AGAR CORPORATION

Process Measurement & Control Solutions



NOTE 1: DEWATERING OF STORAGE TANKS, AUTOMATIC DRAW WATER CONTROL, & MANUAL TANK GAUGING

INTRODUCTION

Storage tanks containing hydrocarbon feedstocks, intermediates and finished products will, over time, accumulate a water layer in the tank bottoms, (exceptions are water soluble hydrocarbons such as alcohols and ethers). Standard industry practice is to periodically drain the water from storage tanks so that the water does not adversely impact specifications of the hydrocarbon. Water removal also reduces corrosion problems on the floor of the tank.

Manual control of water draw-off can result in HC product in the discharge. The loss of this HC product means less product available for sale and increases the cost of wastewater treatment. Additionally, environmental regulation trends (e.g., USA Benzene/NESHAP and SOCM/HON) may impose large economic penalties for designing water draw conveyance and treatment systems that allow HC product in the water draw-off discharge.

Two types of water draw-off control approaches use the AGAR ID-200 Series Interface Detector. Each water draw discharge control strategy has its own advantages and disadvantages.

The control strategies are:

1. Using In-Tank Interface/Concentration Detectors
2. Using Insertion Hydrocarbon/Water Monitors in the Effluent Water Draw-Off Line

AGAR applications specialists can assist in identifying the optimum strategy for controlling draw water discharge.



I. IN-TANK INTERFACE DETECTOR

In-Tank measurement of the hydrocarbon/water interface gives the best results for eliminating the discharge of hydrocarbons. Usually an AGAR ID-201 probe is inserted into the tank through AGAR's patented seal housing, as shown in the photo above. Special installation may require the use of the AGAR ID-202 for extended length.

APPLICATION NOTE 1

APPLICATION NOTE 1 - Dewatering

The two probe system can operate under two strategies. A main control/safety strategy - **System #1** shown in figure 2A and a high-low control strategy - **System #2** shown in Figure 2B.

System #1

When the AGAR ID-201 probe detects HC free water, the water discharge valve is opened. As water is drained off the bottom of the tank, the hydrocarbon/water interface begins to drop. When the AGAR ID-201 probe detects the hydrocarbon/water interface, the signal is sent to close the discharge valve. Output options to control the valve can be 4-20 mA, relay and/or pneumatic. Local indicating lights are also available. If the hydrocarbon floats, the ID-201 will prevent it from being discharged with the waste water.

Figure 2A shows an upper probe used for control, with the lower probe used for low level alarm and positive shutdown of the water discharge valve.

SYSTEM 1 CONTROL LOGIC			
	WATER (VALVE OPEN)	ALARM (VALVE CLOSED)	OIL (VALVE CLOSED)
HIGH	WATER	OIL/WATER	OIL
LOW	WATER	OIL	WATER

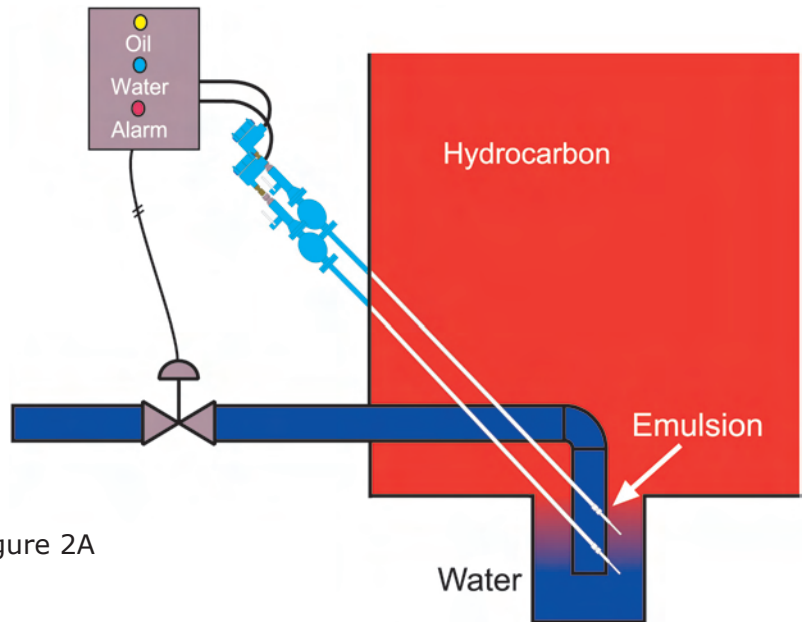


Figure 2A

System #2

Figure 2B shows the high-low control logic in which the valve would close only after both probes have detected hydrocarbon. Figure 2A and 2B also shows how to overcome tank bottom sludge build-up problems by placing the active part of the AGAR ID-201 probe over the sump in the bottom of the tank. (It is nearly impossible for sludge to build-up and cover the probes in this configuration.)

SYSTEM 2 CONTROL LOGIC					
ID-201 PROBES		VALVE STATUS	LIGHTS		
HIGH	LOW		OIL	WATER	ALARM
WATER	WATER	OPEN	OFF	ON	OFF
OIL	WATER	OPEN	OFF	ON	OFF
OIL	OIL	CLOSED	ON	OFF	OFF
OIL	WATER	CLOSED	ON	OFF	OFF
WATER	WATER	OPEN	OFF	ON	OFF
WATER	OIL	CLOSED	ON	OFF	ON

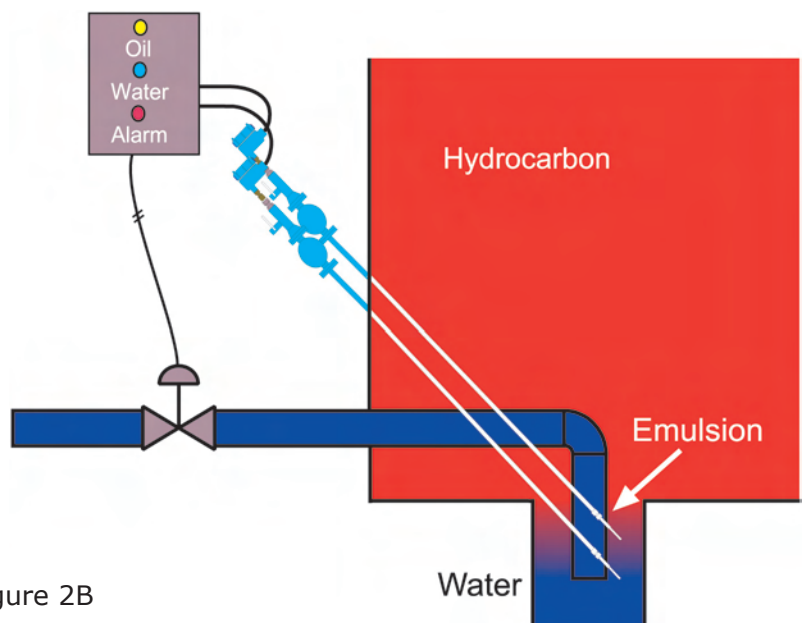


Figure 2B

II. IN-LINE HYDROCARBON/WATER MONITORS

The advantage of this approach is the avoidance of tank penetration, problems with bottom sediments build-up, and eliminating most of the free water in the tank.

However, there are significant disadvantages that should be considered in design and policy decisions:

1. Some hydrocarbon must be discharged with the waste water in order for the monitor to detect it in the external pipe.
2. The drain pipe must be altered to avoid trapping of hydrocarbons.
3. Manual initiation of water draw cycle is required.

Figure 3 shows how the conventional Vortex Breaker bent pipe traps hydrocarbon at the end of the water draw-off cycle.

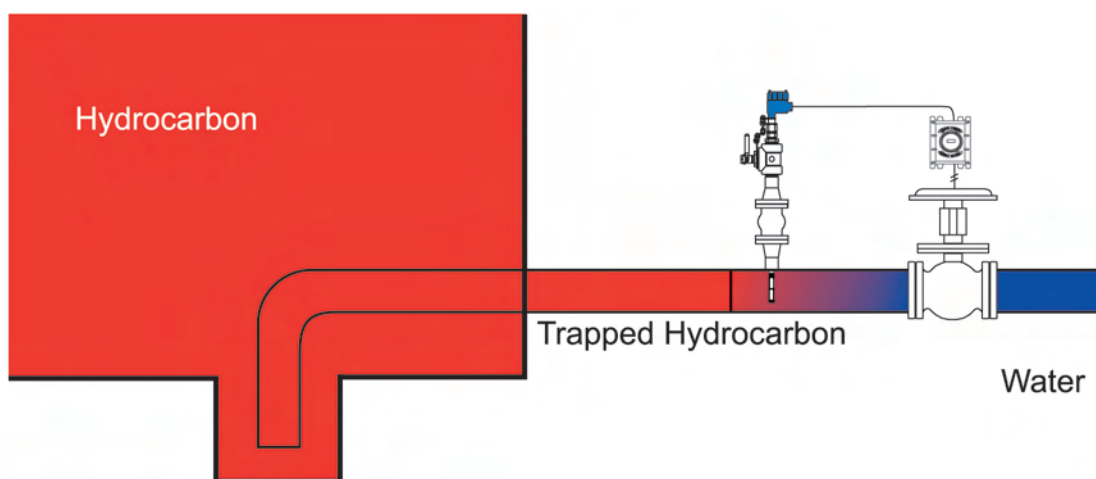


Figure 3

Assume a case where the hydrocarbon and the water have completely “phase separated” to form a clear-cut interface inside the tank. Because hydrocarbon is still present from previous water-draw, the water draw cycle will have to be initiated manually. Water will have to displace the HC before the probe can be activated. Once this has occurred, water will continue to drain until the oil/water monitor again detects hydrocarbons. At this point, the oil/water monitor will send a control signal that is used to close the water draw-off valve. However, due to the bent pipe design, this hydrocarbon is trapped in the draw-off line. As water gradually builds up in the tank, the hydrocarbon trapped in the line acts as a seal (being lighter than water). To re-activate the dump valve for a new water draw cycle, the oil/water monitor signal must be overridden for some time to flush the hydrocarbon out of the line before water is again detected.

There is no assurance that there will be sufficient water in the tank to flush all hydrocarbon out of the water draw-off line. Thus, the pipe must be designed in such a way as to eliminate the trapping of hydrocarbon. A small upward inclination is desirable, with a vortex breaker at the intake. The latter avoids vortexing and the suction of hydrocarbon with water when the dump valve is fully open. Figure 4 shows hydrocarbon being discharged with the water because of the vortex action.

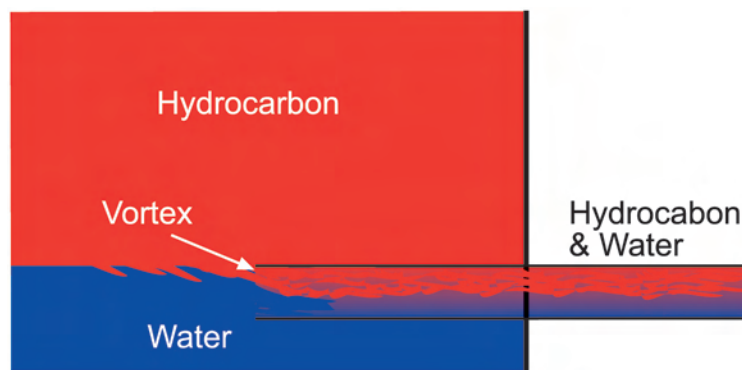


Figure 4

APPLICATION NOTE 1 - Dewatering

Figure 5 shows the correct installation with a slotted discharge pipe. Note that the cross-section of the slot must be at least ten times larger than the cross-section of the pipe. Similarly, the pipe can be perforated with many holes, whose total cross-section area exceeds the pipe's area by a factor of ten

If the hydrocarbon is highly viscous, special care must be taken to compensate for hydrocarbon fouling that will stick to pipe walls and the AGAR oil/water monitor. The amount of hydrocarbons discharged will depend on the oil's viscosity and the flushing action of the effluent water. Calibration adjustments to the oil/water monitor will negate the effects of fouling.

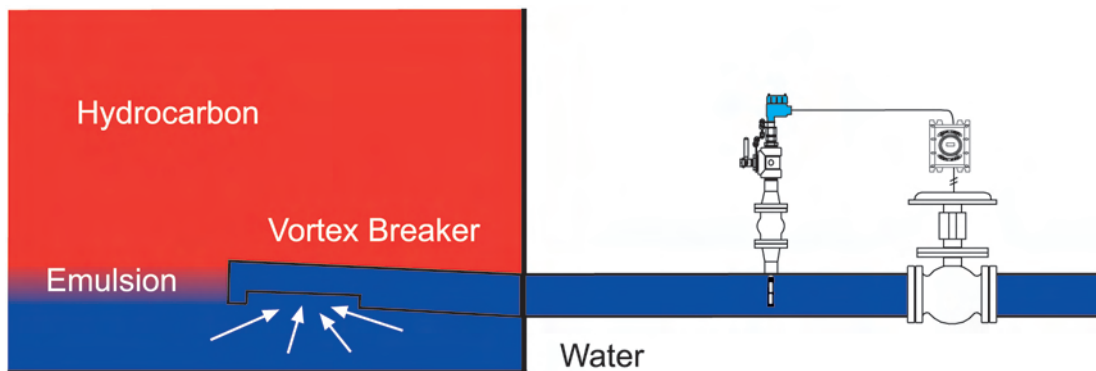


Figure 5

USA
 Agar Corporation
 5150 Tacoma Drive
 Houston, TX 77041
 Tel: (832) 476-5100
 Fax: (832) 476-5299
 ACL@agarcorp.com

CAYMAN ISLANDS
 Agar Corporation Ltd.
 P.O. Box 10206
 Grand Cayman, BWI
 KY1-1002
 Tel: (345) 945-5242
 ACL@agarcorp.com

VENEZUELA
 Agarcorp de Venezuela C.A.
 Edif. First, Piso 1, Local 1-B
 Calle 75 con Av. 13-A
 Maracaibo, Edo. Zulia
 Tel/Fax: +58 261 7978646
 ADV@agarcorp.com

MALAYSIA
 AgarCorp SDN. BHD.
 168-1st Fl Main Rd Salak So
 57100 Kuala Lumpur
 Tel: 603-7980-7069
 Fax: 603-7980-5369
 ACSB@agarcorp.com

UNITED ARAB EMIRATES
 AgarCorp Middle East
 P.O. Box 41296
 Abu Dhabi, UAE
 Tel: 971-2-6811150
 Fax: 971-2-0811779
 ACAD@agarcorp.com

INDONESIA
 PT AgarCorp Indonesia
 Jalan Teratai CB-17
 Ciputat Baru, Ciputat
 Tangerang 15413
 Tel: 62 21 7409206
 PTAI@agarcorp.com



AGAR CORPORATION
www.agarcorp.com